# EXHIBIT 13

## Vaulted Aboveground Storage Tank Configuration *(Optional)*

This exhibit allows an alternate tank storage configuration for the Assist EVR system. A vaulted aboveground storage tank (AST) may be installed in substitute for a conventional underground storage tank (UST). The figures in this exhibit provide examples of typical vaulted AST configurations.


## 1. GENERAL SPECIFICATIONS

1.1. Alternate typical vaulted AST configurations for the Assist Phase II EVR System are shown in Figures 13-1, 13-2, 13-3, and 13-4.


1.2. Unless otherwise specified in this Executive Order (EO), the vaulted AST configuration shall comply with the applicable performance standards and performance specifications in CP-201. The emergency vent shall be a certified vent listed in the Phase I EVR Executive Orders for ASTs and shall be installed, operated, maintained and meet any performance requirements specified in the applicable AST Executive Order.

**FIGURE 13-1**


**Front Sectional Views of Typical Vaulted AST**

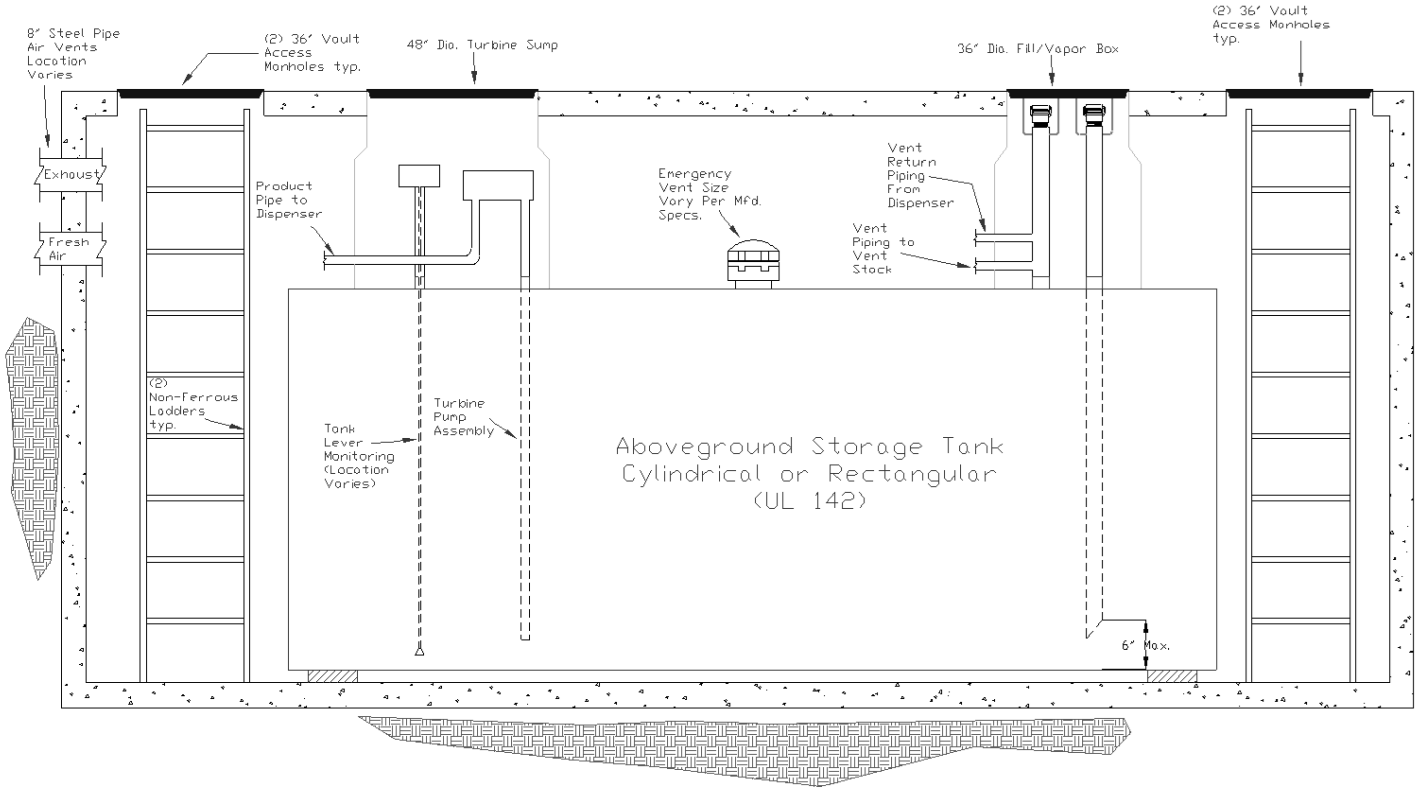

## FIGURE 13-3
## Top Sectional View of Typical Vaulted AST

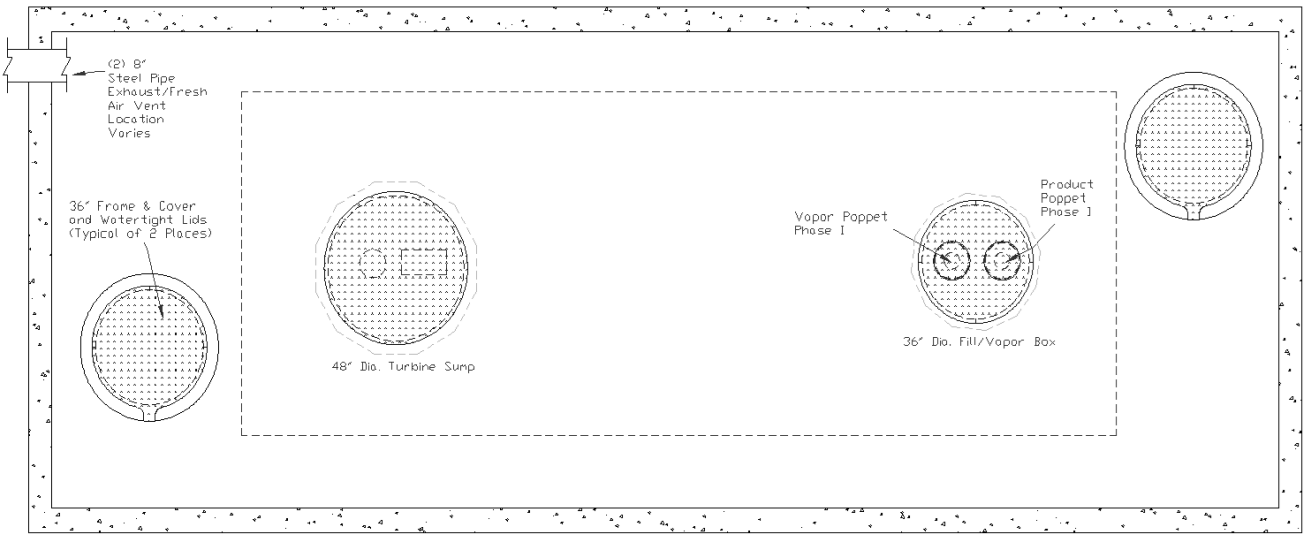


## FIGURE 13-2
## End Sectional View of Typical Vaulted AST

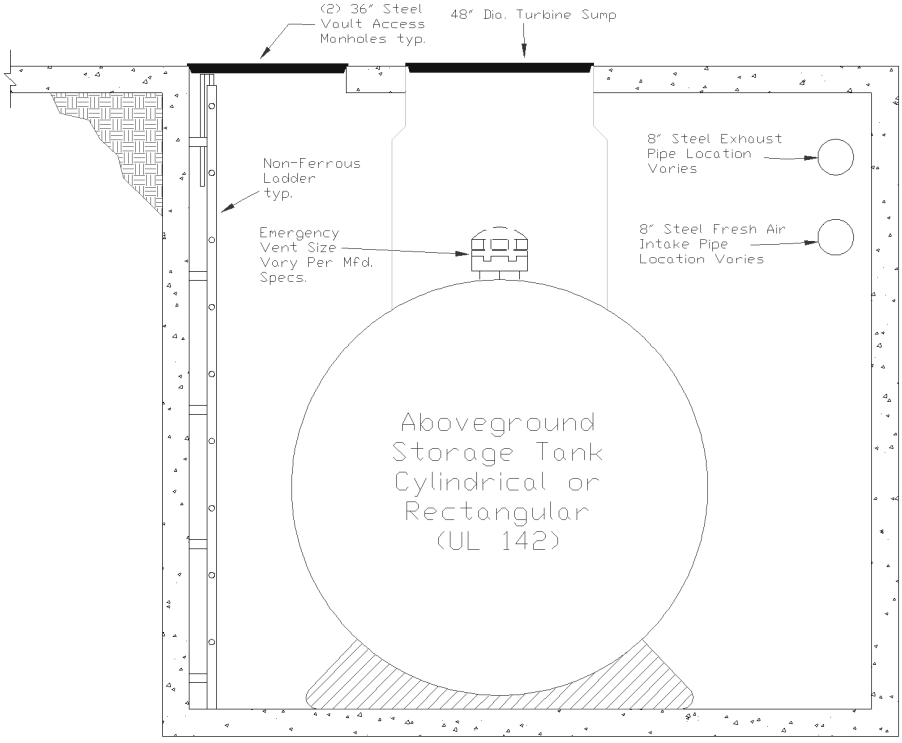

## FIGURE 13-4

## Sectional Views of Typical Vaulted AST (Ventilation)

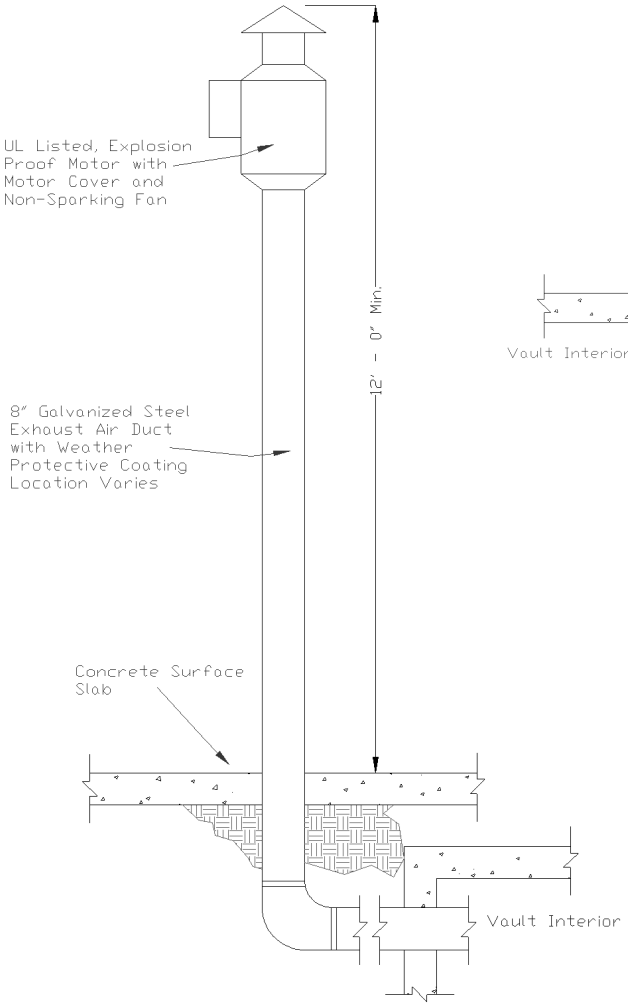



**Figure 13-4a:** Typical Exhaust

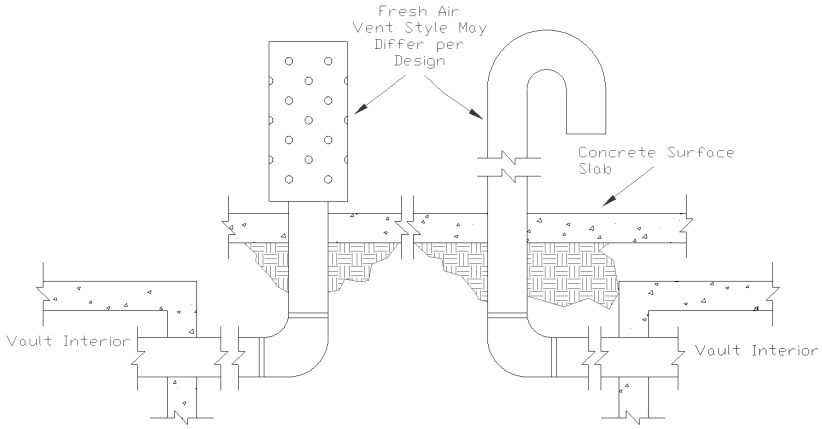



**Figure 13-4b:** Typical Fresh Air Intake